

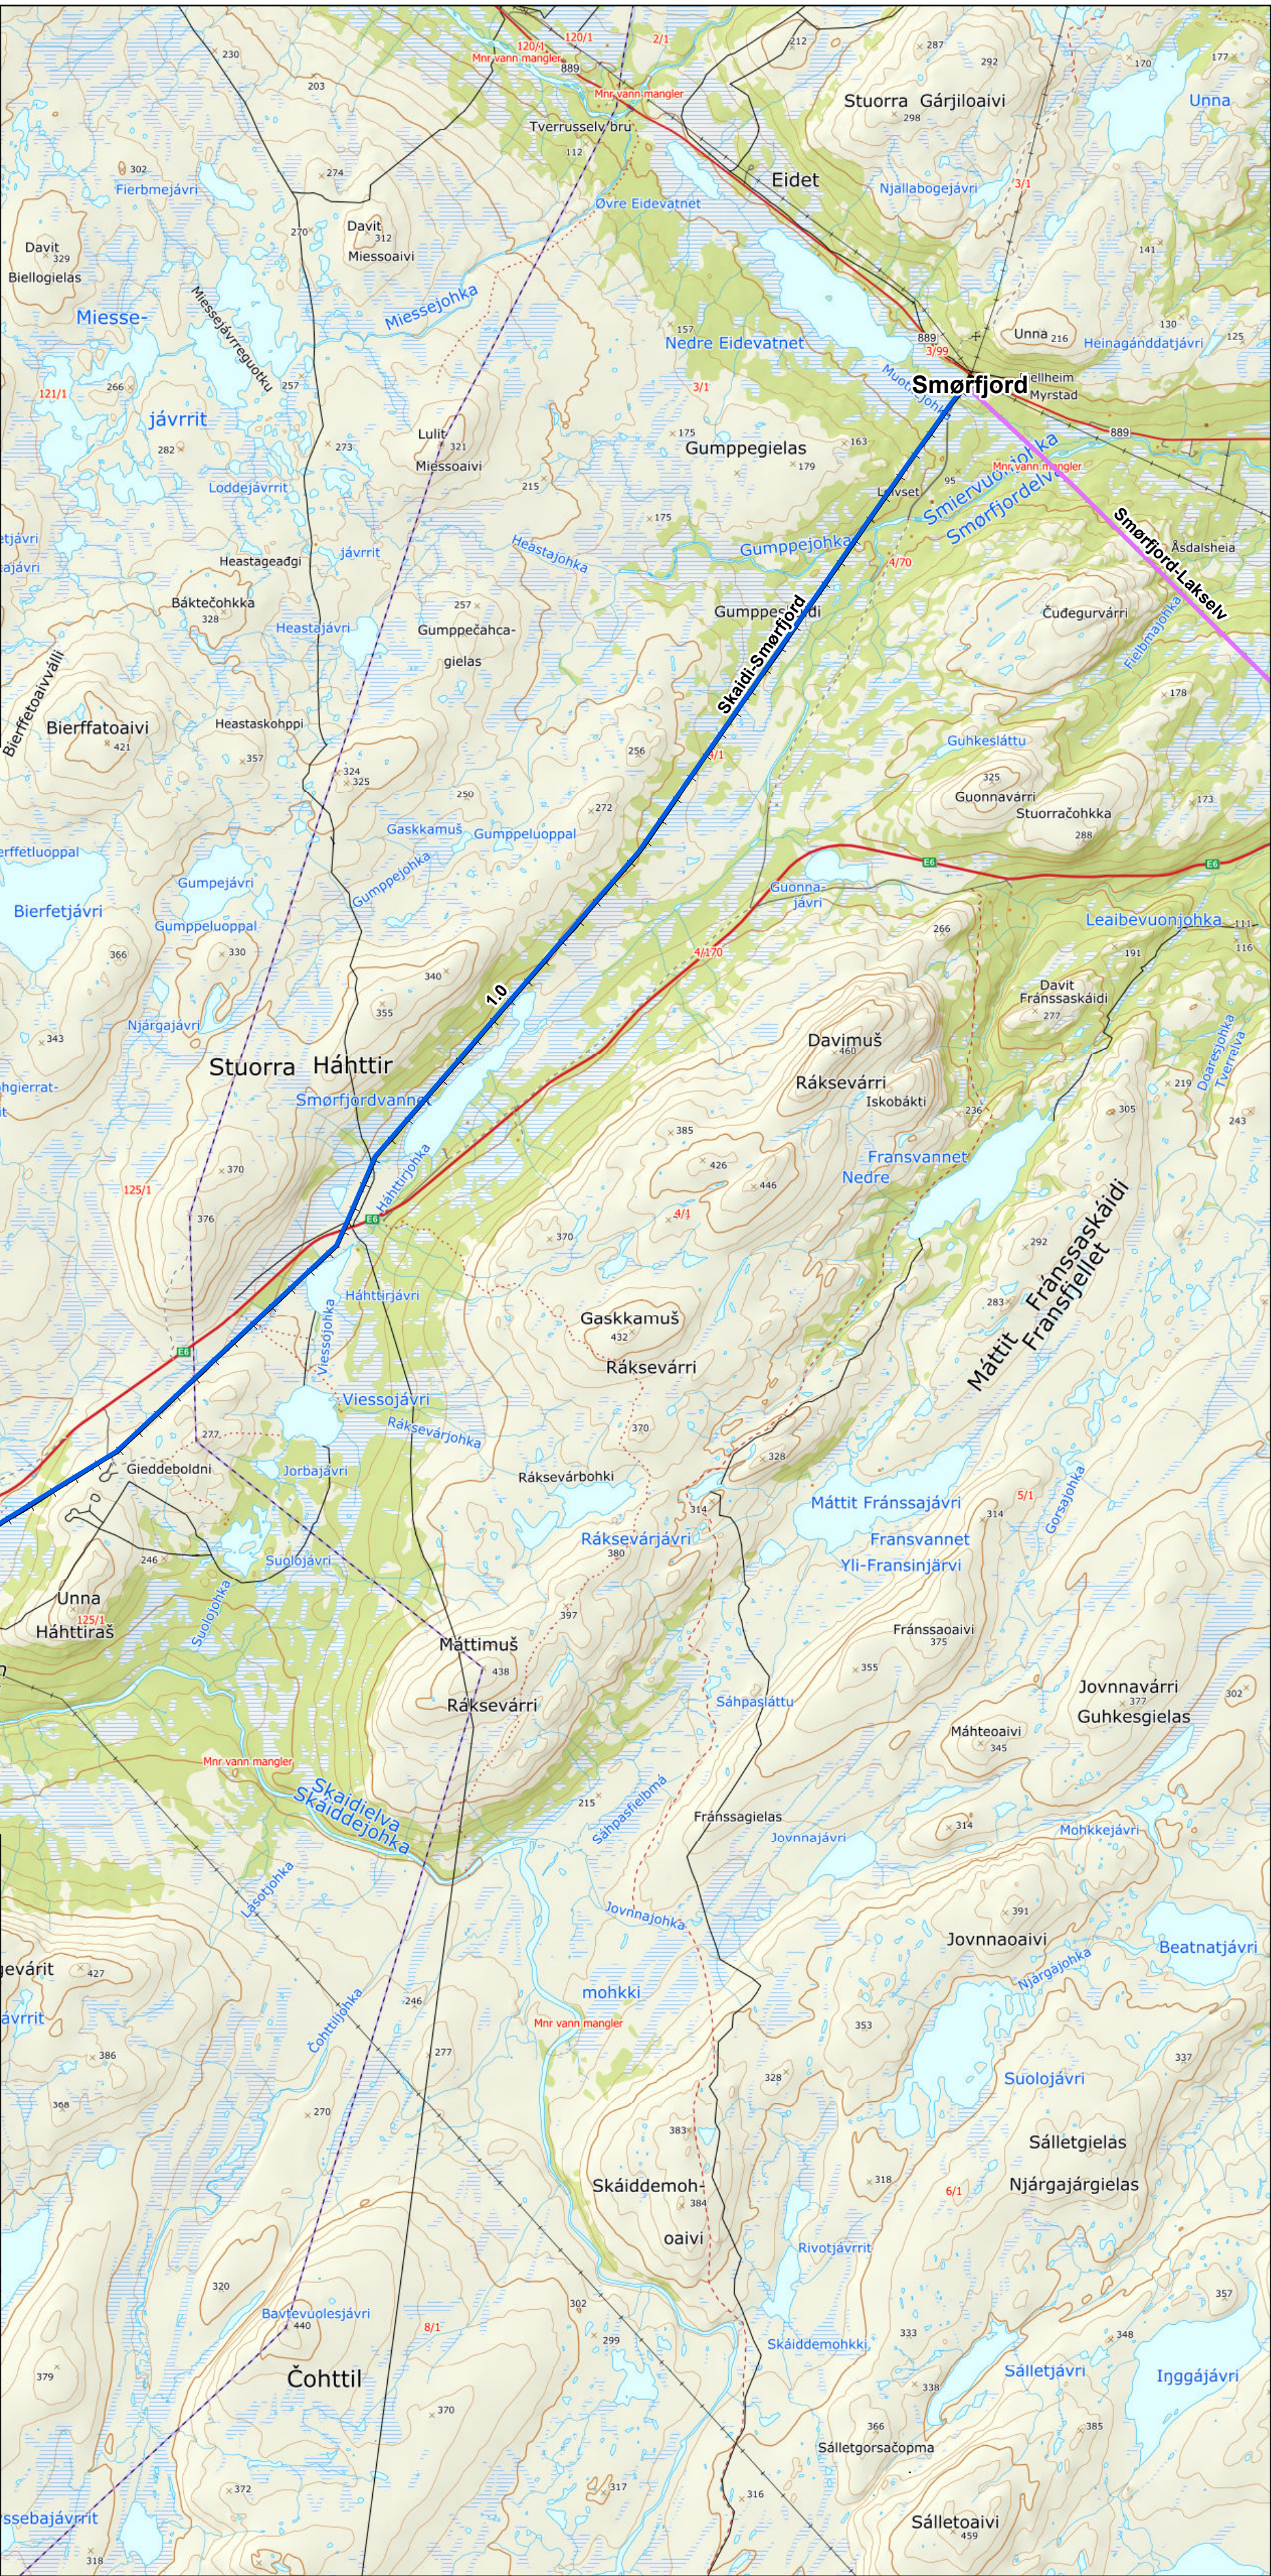


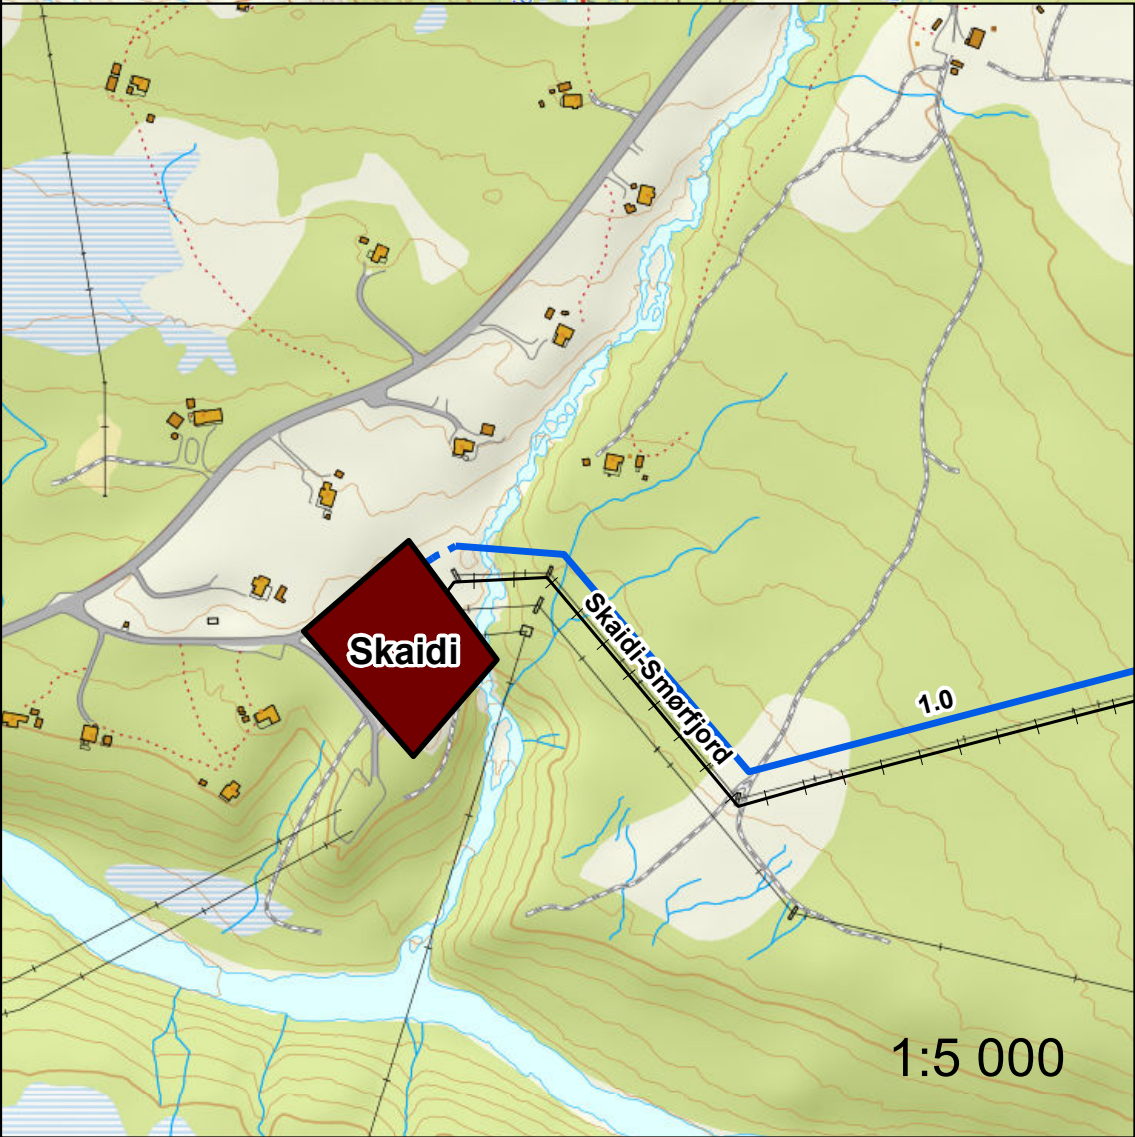

Tegnforklaring

- Eksisterende ledning
- Eksisterende ledning, nedklassifisert 22 kV
- Ny 132 kV jordkabel
- Ny 132 kV luftledning
- Ledning rives
- Transformatorstasjon

Kilometer 0 1,5 3

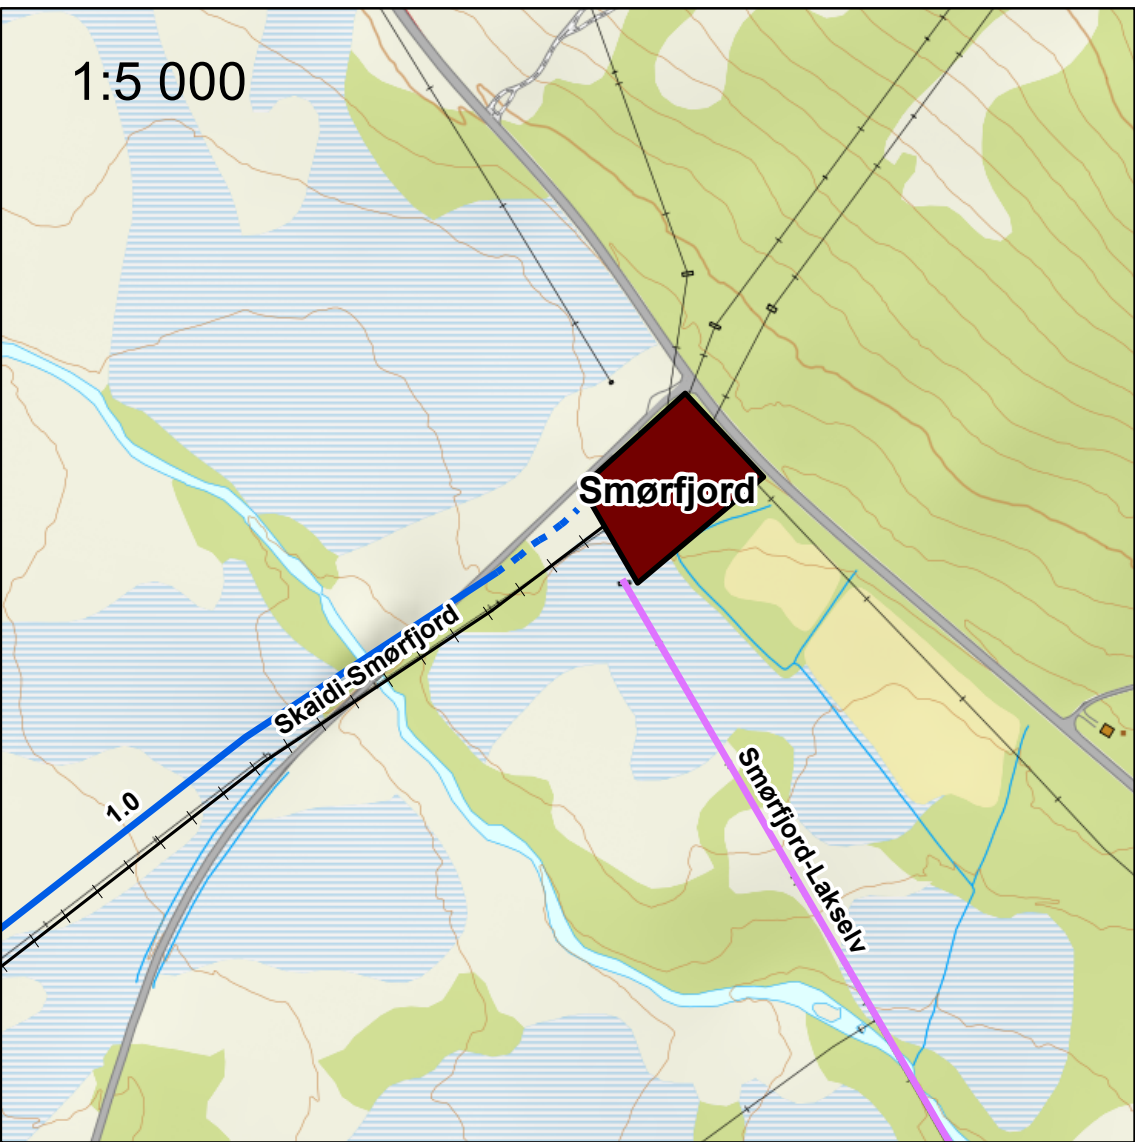

A01	26.02.2020	Fagkontroll	MS	OK	MS
Version	Dato	Beskrivelse/ending	Tegn.	Kontr.	Godk.
Tiltakshavar			Målestokk i A2		
Repvåg Kraftlag SA			1:50 000		
NY 132 (66) KV SKAIDI-SMØRFJORD VEDLEGG 1, MELDINGSKART					
Utarbeidd av		Prosjektnr	Kartblad	Rev	
Norconsult 		5200868	Nybygging	A01	